



**STOP** if not clear how to do the work

# Critical Lifting | Critical Checklist



## When to use

**Important: Attach to completed JSA**

When Heavy Equipment Lifting Critical Checklist has determined lift to be Critical


**Owner's representative or designee must be informed 72 hours prior to any critical lift activity**

Work Order Number:	Site Location:
Lifting Contractor:	Date:
Description of work:	Lift Radius:
Load Weight (max load weight and radius for group of lifts):	Crane's rated Capacity at lift radius:
Name of critical lift plan approver:	Date:
What could go wrong?:	

## BEFORE work begins | Create Critical lift plan

**Done**

- 1. At least 72 hours prior to actual lift, create a **Critical Lift Plan** to include the following:
  - Elevation view drawing
  - Boom length \_\_\_\_\_ m and lifting radius \_\_\_\_\_ m
  - Maximum load during lifting procedure \_\_\_\_\_ tonnes
  - Minimum boom clearances (load, obstructions or power lines) \_\_\_\_\_ m
  - Plan view drawing(s)
  - Initial/final lifting position and radius
  - Location of the crane(s), including tail-swing limits, nearby structure
  - Lift analysis including calculation of crane capacity at lift radius \_\_\_\_\_ %
  - Abort plan for emergency situations to bring the load back down to the ground in a safe manner
- 2. Operator is trained, competent, with valid license, in safe operation of crane
- 3. Crane(s) located at correct position as per Critical Lift Plan
- 4. Each crane supported on firm, stable base/foundation, outriggers deployed and blocked
- 5. Lift equipment / apparatus / all riggings is appropriate for the lift, is in good condition, meets manufacturer's specifications, with valid certification(s) and does not exceed rated capacity
- 6. Equipment or materials to be lifted are stable, wrapped and tied; lifting apparatus are securely fixed and balanced
- 7. Review minimum required clearance between live electrical lines and any part of the crane, load, or load line - see table at right:
- 8. Lift area and swing radius including exclusion zones are established, barricaded, and traffic controls are in place
- 9. Equipment operator(s) have a clear view of the work area
- 10. Dedicated signaller(s)/spotter(s) are used and communication method with each signaller/spotter is defined and understood
- 11. Use of proper tag line(s) / guiding rope(s) for suspended loads
- 12. Good access and egress in case of emergency
- 13. All persons including those receiving the load and inside buildings to keep a safe distance from lifting activity (no persons under suspended load)

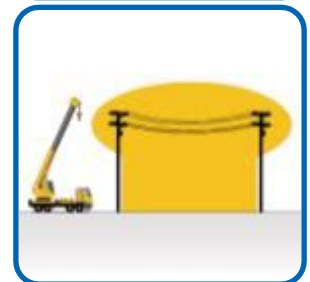

Voltage (V)	Minimum Clearance (m)
750–150k	3.0
150k–250k	4.5
>250k	6.0



Equip. Operator:	Signature:	Date:
Spotter:	Signature:	Date: